# SIEMENS



ACVATIX™

# Modulating control valves with magnetic actuator, PN16

# M3P..FY M3P..FYP

for chilled and low-temperature hot water systems or for systems with media containing mineral oils (M3P..FYP)

- Fast positioning time (1 s), high-resolution stroke (1 : 1000)
- Positioning signal: DC 0...10 V or DC 4... 20 mA
- Fail-safe feature:  $1 \rightarrow 3$  closed when de-energized
- Low friction, robust, no maintenance required
- Indication of operating state, position feedback and manual control

#### Use

|                                | The control valves are mixing or throughport valves with the ready fitted magnetic actu-<br>ator for position control and position feedback. The short positioning time, high resolu-<br>tion and high rangeability make these valves ideal for modulating  |
|--------------------------------|---|
| M3PFY                          | <ul> <li>control of chilled and low-temperature hot water systems</li> </ul>  |
| M3PFYP                         | <ul> <li>control or dosing control of fluids containing mineral oil (SAE05SAE50), mineral-oil-<br/>based diesel fuels, heat transfer oils<br/>in closed circuits.</li> </ul>  |
| Application examples<br>M3PFYP | <ul> <li>Temperature control in mixing circuits for motor oil circulation, screw-compressors (compressed air) and fuel circuits for petrol and diesel oil</li> <li>High pressure control for the calibration of components for electronic injection components</li> <li>Control of cutting-oil emulsion for industrial grinding machines</li> </ul> |

## **Building Technologies**


|   | Type reference         |  | DN   | l k <sub>vs</sub> ∆p <sub>max</sub>   |  | ∆p <sub>s</sub> Operatin   | Operating   | Positioning Spring                             |  |   |                    |
|---|------------------------|--|--|---|--|--|---|--|--|---|--------------------|
|   | M3PFY                  | M3PFYP <sup>1)</sup>   | DI   | [m <sup>3</sup> /h] [kPa]   | [kPa]  | voltage  |   |  | return                                   |   |                    |
|   | M3P80FY                | M3P80FYP   | 80   | 80  | 300  | 300  |   |  |  |   |                    |
|   | M3P100FY               | M3P100FYP  | 100  |   |  |  | AC 24 V   | DC 01<br>DC 42                                 |  | < 2 s   | ~                  |
| Accessories<br>Set of blank flanges   | 1]<br>Δ<br>Δ<br>κ      | for media con<br>for media con<br>DN = Nomina<br>Ap <sub>max</sub> = max. p<br>actuati<br>Ap <sub>s</sub> = max. p<br>close s<br>Gys = nomina  | taining<br>al size<br>ermiss<br>ng ran<br>ermiss<br>ecurel<br>al flow<br>ntial pr<br>MXF4<br>s MXC<br>a<br>B   | sible differe<br>ge of the m<br>sible differe<br>ly against th<br>rate of colo<br>ressure of 1<br>461, MXF4<br>G461, MX | ntial pres<br>notorized<br>ntial press<br>ne pressu<br>water (5<br>00 kPa (*<br>161P<br>G461P<br>G461P | sure across<br>valve<br>sure (close<br>to 30 °C) t<br>1 bar)<br>DN 15<br>DN 15 | e off pressure)<br>s throughport<br>through the ful | control par<br>at which<br>valve)<br>ly opened | th, valic<br>the mo<br>d valve<br>datash | torized va<br>(H <sub>100</sub> ) at a<br>neet N445 | lve will<br>a<br>5 |
|   | -                      | Z155/100<br>SEZ91.6  | Blank flange kit for flanged valve with DN 100. Contains blank flange, seal, screws, spring washers and nuts         External interface for DC 020 V phase cut control signal, refer to data she N5143 |   |  |  |   |  |  |   |                    |
| Order   | V                      | Vhen ordering  | , plea   | ase give (  | quantity   | , product  | name and t  | ype refe                                       | rence                                    |   |                    |
| Delivery  | F                      | Product numb   | er   | Order nu  | mber   | er Description   |   |  |  |   |                    |
|   | N                      | //3P80FY   |  | M3P80FY Flanged valve with magnetic actuator  |  |  |   |  |  |   |                    |
|   | Z                      | Z155/80 Z155/80 Set of blank flanges   |  |   |  |  |   |  |  |   |                    |
| Daulaaamant   | Г                      | /alve body an<br>The valve and   | blanl  | k flanges   | are pac  | ked and s  | supplied sep  | parately                                       |  |   |                    |
| Replacement<br>electronics module<br>ZM250  | e t                    | Should the valve electronics prove faulty, the electronics module must be replaced by the ZM250 replacement electronics module. Mounting Instructions no. 35731 are included.  |  |   |  |  |   |  |  |   |                    |
| Rev. no.  | S                      | See overview,  | page   | e 10.   |  |  |   |  |  |   |                    |
| Technical and med   | hanical de             | sign   |  |   |  |  |   |  |  |   |                    |
|   | F                      | or a detailed  | desc   | ription of  | operatic   | on, refer t  | o data shee   | t CA1N₄  | 4028E                                    |   |                    |
| Control operation   | g<br>ii<br>e<br>s<br>c | The control signal is converted in the terminal housing into a phase cut signal which generates a magnetic field in the coil. This causes the armature to change its position in accordance with the interacting forces (magnetic field, counterspring, hydraulics etc.). The armature responds rapidly to any change in signal, transferring the corresponding movement directly to the control disc, enabling fast changes in load to be corrected quickly and accurately. |  |   |  |  |   |  | osition<br>lics<br>orre-<br>o be         |   |                    |
| The valve position is inductively measured contin<br>is rapidly corrected by the internal positioning con<br>signal and the valve stroke are exactly proportion |                        |  |  |   |  | controller, v  | which er  | nsures   | that the                                 | contro  |                    |

signal and the valve stroke are exactly proportional, and also provides a feedback signal indicating the valve position.

2/10

| Control                | The magnetic actuator can be driven by a Siemens controller or a controller of other manufacture that deliver a DC 0/210 V or DC 4 20 mA output signal.  |
|------------------------|--|
| Spring return function | To achieve optimum control performance, it is recommended to use a 4-wire connection.<br>If the positioning signal is interrupted, or in the event of a power failure, the valve's return spring will automatically close control path $1 \rightarrow 3$ .   |
| Manual control         | Control path ports 1 -> 3 can be opened mechanically to between 0 and approximately 90 %, by turning the hand wheel clockwise.<br>The manual adjustment facility can also be used as a mechanical method of low limit control, i.e. the valve will exercise its normal control function between the manually-set position and the 100 % open position. For full-stroke automatic control, the hand wheel must be set to 0 (the counterclockwise end stop). |



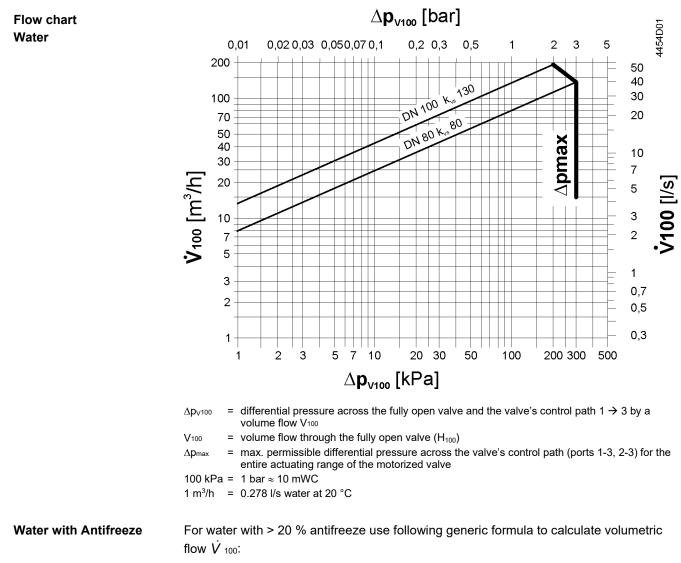

Generic formula

$$\vec{V}_{100} = \frac{\mathbf{Q}_{100} \cdot 3600}{\mathbf{c} \cdot \Delta T \cdot \rho} \begin{bmatrix} m^3 / h \end{bmatrix} \qquad \begin{array}{c} \dot{V}_{100} \\ \mathbf{Q}_{100} \\ \Delta T \\ \mathbf{c} \\ \rho \end{array}$$

| = Temperature difference between flow and return | [K]      |
|--|----------|
| = specific heat capacity                         | [kJ/kgK] |
| = specific density                               | [kg/m³]  |
|  |          |
|  |          |

= Volumetric flow

= Design energy demand

[m<sup>3</sup>/h]

[kW]

When sizing valves for media other than water, note that the medium properties

- specific heat
- density
- kinematic viscosity

differ from water. All variables depend on temperature.


The design temperature is the lowest medium temperature in the valve.

Note on viscosityViscosity may change considerably on temperature changes depending on the medi-<br/>um. Plant functionality may be impaired if the medium temperature does not guarantee<br/>viscosity values compatible with troublefree valve functioning.

Kinematic viscosityKinematic viscosity  $\upsilon$  [mm²/s] in HVAC plants always is lower than 10 mm²/s, i.e. its $\leq 10 \text{ mm²/s}$ influence on volume flow is negligible.

> 10 mm<sup>2</sup>/s For details please contact your local Siemens branch office.

#### Valve characteristic

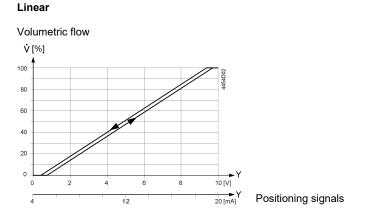

#### Connection type <sup>1)</sup>

4-wire connection

3-wire connection

The 4-wire connection to the valve should always be given preference!

|                | SNA     | PMED    | STR     | IF  | Wire cross-section [mm <sup>2</sup> ] |             |                  |  |
|----------------|---------|---------|---------|-----|---------------------------------------|-------------|------------------|--|
| <b>T</b>       | D ( A ] | F) A /7 | D ( A ] | 543 | 1.5                                   | 2.5         | 4.0              |  |
| Type reference | [VA]    | [W]     | [VA]    | [A] | max                                   | . cable len | <b>gtn L</b> [m] |  |
| M3P80FY        | 80      | 20      | 100     | 6.3 | 10                                    | 16          | 27               |  |
| M3P100FY       | 120     | 30      | 150     | 10  | 6                                     | 10          | 17               |  |
| M3P80FYP       | 80      | 20      | 100     | 6.3 | 10                                    | 16          | 27               |  |
| M3P100FYP      | 120     | 30      | 150     | 10  | 6                                     | 10          | 17               |  |
| M3P80FY        | 80      | 20      | 100     | 6.3 | 10                                    | 16          | 27               |  |
| M3P100FY       | 120     | 30      | 150     | 10  | 6                                     | 10          | 17               |  |
| M3P80FYP       | 80      | 20      | 100     | 6.3 | 10                                    | 16          | 27               |  |
| M3P100FYP      | 120     | 30      | 150     | 10  | 6                                     | 10          | 17               |  |

 $S_{NA}$  = nominal apparent power for selecting the transformer

P<sub>med</sub> = typical power consumption

 $S_{TR}$  = Minimal required transformer power

 $I_N$  = required slow fuse

L

= max. cable length; with 4-wire connections, the max. permissible length of the separate 1.5 mm<sup>2</sup> copper positioning signal wire is 200 m

 $^{\mbox{\tiny 1)}}$  All information at AC 24 V

|                                    | Conduct the electric connections in accordance with local regulations on electric installations as well as the internal or connection diagrams.   |
|------------------------------------|---|
| Attention $\triangle$              | Safety regulations and restrictions designed to ensure the safety of people and property must be observed at all times!   |
| Attention $\triangle$              | A strainer should be fitted upstream of the valve. This increases reliability.  |
| Mounting notes                     |   |
|                                    | Two mounting instruction leaflets are enclosed with the valve: Ref. 35638 (valve) and reference 35731 (terminal housing).   |
| Attention $\triangle$              | The valve may only be used as a mixing or throughport valve, not as a diverting valve. Observe the direction of flow 1 $\rightarrow$ 3!   |
| Orientation                        |   |
| Access for installation            | It is essential to maintain the specified minimum clearance above and to the side of the actuator and/or electronics module! (refer to "Dimensions", page 10)                           |
| Use as straight-<br>through valves | Close off port '2' with the type Z155/ accessories, which must be ordered separately. For details see page 2. The blank flange kit consists of a seal, screws, spring washers and nuts. |
| Installation notes                 |   |
|                                    | The actuator must not be lagged   |

- For notes on electrical installation, see "Connection terminals" respectively "Connection diagram", page 9.
- Calibration valve electronics See mounting instruction on Siemens HIT Portal: ZM250 (page 2, step 10 – 12)

Maintenance notes

The valves and actuators are maintenance-free.

The low friction and robust design make regular servicing unnecessary and ensure a long service life.

The valve stem is sealed from external influences by a maintenance-free gland.

Repair Should the valve electronics prove faulty, the electronics module should be replaced with replacement part ZM250. Mounting instructions are enclosed (Ref. 35731).

Warning  $\triangle$  Always disconnect the power before fitting or removing the terminal housing. The terminal housing is calibrated and matched to the actuator, and should be replaced only by qualified personnel.



Under operating conditions within the limits defined by the application data, the actuator will become hot, but this does not represent a burn risk. Always maintain the minimum clearance specified, refer to "Dimensions", page 10.

Disposal



The device is considered electrical and electronic equipment for disposal in terms of the applicable European Directive and may not be disposed of as domestic garbage.

- Dispose of the device through channels provided for this purpose.
- Comply with all local and currently applicable laws and regulations.

### Warranty

Application-specific technical data must be observed.

If specified limits are not observed, Siemens will not assume any responsibility.


### **Technical Data**


| Functional actuator data |   | M3P80FY<br>M3P80FYP   | M3P100FY<br>M3P100FYP |  |  |  |
|--------------------------|---|---|-----------------------|--|--|--|
| Power supply             | Extra low-voltage only (SELV, PEL)                  | V)  |                       |  |  |  |
|                          | Operating voltage                                   | AC 24 V ±20% (SELV) c   | pr                    |  |  |  |
|                          |   | AC 24 V class 2 (US)  |                       |  |  |  |
|                          | Frequency   | 5060 Hz   |                       |  |  |  |
|                          | Typical power consumption P <sub>med</sub>          | 20 W  | 30 W                  |  |  |  |
|                          | stand by (valve closed)                             | < 2 W   | < 2 W                 |  |  |  |
|                          | Rated apparent power S <sub>NA</sub>                | 80 VA   | 120 VA                |  |  |  |
|                          | Minimal required transformer                        | 100 VA  | 150 VA                |  |  |  |
|                          | power S <sub>TR</sub>                               |   |                       |  |  |  |
|                          | Required fuse I⊧                                    | slow, see table «Connecti   | on type», page 4      |  |  |  |
|                          | External supply line protection                     | Fuse slow max. 10 A   |                       |  |  |  |
|                          |   | or  |                       |  |  |  |
|                          |   | Circuit breaker max. 13 A   |                       |  |  |  |
|                          |   | Characteristic B, C, D according to EN 60898                            |                       |  |  |  |
|                          |   | or  |                       |  |  |  |
|                          |   | Power source with current limitation of max. 10 A                       |                       |  |  |  |
| Input                    | Positioning signal Y                                | DC 010 V or DC 420 mA   |                       |  |  |  |
|                          | Impedance DC 010 V                                  | ce DC 010 V > 400 k $\Omega$ // 30 nF (load < 0.1 mA)                   |                       |  |  |  |
|                          | DC 420 mA   | 100120 Ω // 30 nF   |                       |  |  |  |
| Output                   | Position feedback signal                            | DC 010 V (max. 9.7 V ± 0.2 V)   |                       |  |  |  |
|                          | Max. load   | max. 1.5 mA   |                       |  |  |  |
|                          | Stroke measurement                                  | Inductive   |                       |  |  |  |
|                          | Nonlinearity  | ± 3 % of end value  |                       |  |  |  |
|                          | Positioning time                                    | < 2 s   |                       |  |  |  |
| Electrical wiring        | Cable entry   | 2 x Ø 13.1 mm   |                       |  |  |  |
|                          | Connection terminals                                | Screw terminals for max. 1 x 4 mm <sup>2</sup> wire                     |                       |  |  |  |
|                          | Minimal wire cross-section                          | 1.5 mm <sup>2</sup>   |                       |  |  |  |
|                          | Maximum cable length                                | refer to "Connection type", page 4                                      |                       |  |  |  |
| Functional valve data    | PN class  | PN 16 to EN 1333  |                       |  |  |  |
|                          | Permissible operating pressure                      | 1 MPa (10 bar)  |                       |  |  |  |
|                          | Differential pressure $\Delta p_{max} / \Delta p_s$ | refer to table "Type summary", page 2                                   |                       |  |  |  |
|                          | Valve characteristic                                | linear (to VDI / VDE 2173), optimized near the clos                     |                       |  |  |  |
|                          |   | ing point   |                       |  |  |  |
|                          | Leakage rate at Δp = 100 kPa                        | $1 \rightarrow 3$ max. 0.05 % k <sub>vs</sub>                           |                       |  |  |  |
|                          | (1 bar)   | $2 \rightarrow 3$ ca. 2 % k <sub>vs</sub> depending on operating condi- |                       |  |  |  |
|                          |   | tions   |                       |  |  |  |


|                                       | Medium temperature<br>Stroke resolution ∆H / H′<br>Hysteresis<br>Position when deenergiz<br>Mode of operation |           | chilled and low-temperature hot water, water with<br>anti-freeze;<br>recommendation: water treatment to VDI 2035<br>Mineral oils SAE05 SAE50, mineral-oil-based<br>diesel fuels, heat transfer oils<br>1120 °C<br>> 1 : 1000 (H = stroke) |
|---------------------------------------|---|-----------|---|
|                                       | Medium temperature<br>Stroke resolution ∆H / H′<br>Hysteresis<br>Position when deenergiz<br>Mode of operation | 100       | Mineral oils SAE05 SAE50, mineral-oil-based<br>diesel fuels, heat transfer oils<br>1120 °C<br>> 1 : 1000 (H = stroke)   |
|                                       | Medium temperature<br>Stroke resolution ∆H / H′<br>Hysteresis<br>Position when deenergiz<br>Mode of operation | 100       | diesel fuels, heat transfer oils<br>1120 °C<br>> 1 : 1000 (H = stroke)  |
|                                       | Stroke resolution ∆H / H <sup>2</sup><br>Hysteresis<br>Position when deenergiz<br>Mode of operation           |           | diesel fuels, heat transfer oils<br>1120 °C<br>> 1 : 1000 (H = stroke)  |
|                                       | Stroke resolution ∆H / H <sup>2</sup><br>Hysteresis<br>Position when deenergiz<br>Mode of operation           |           | 1120 °C<br>> 1 : 1000 (H = stroke)  |
|                                       | Hysteresis<br>Position when deenergiz<br>Mode of operation  |           |   |
| <br>                                  | Position when deenergiz<br>Mode of operation  | ed        | typically 2.9/  |
| <br>                                  | Position when deenergiz<br>Mode of operation  | ba        | typically 3 %   |
| -                                     | I   | .cu       | Control path $1 \rightarrow 3$ closed   |
|                                       | · · · · · · · · · · · · · · · · · · ·   |           | Modulating  |
| l l l l l l l l l l l l l l l l l l l | Mounting position   |           | upright to horizontal   |
| Ī                                     | Manual operation  |           | possible, up to 90%   |
| Materials                             | Valve body  |           | EN-GJL-HB215  |
| -                                     | Plug  |           | CrNi steel  |
|                                       | Seat  |           | Rg5, low-lead to DIN 50430, part 6  |
|                                       | Valve stem seal   | M3PFY     | EPDM (O-Ring)   |
|                                       | ſ   | M3PFYP    | Fluororubber – FPM product (Viton)  |
| -                                     | Bellows   |           | CrNi steel  |
| Dimensions / weight                   | Dimensions  |           | refer to "Dimensions", page 10  |
|                                       | Weight  |           | refer to "Dimensions", page 10  |
| Degree of protection                  | Protection class  |           | Class III to EN 60730   |
| Ī                                     | Pollution degree  |           | Class 2 to EN 60730   |
| Ī                                     | Housing protection  |           |   |
|                                       | Upright to horizontal   |           | IP31 to EN 60529  |
| Standards, directives and approvals   | Product standard: EN  | N 60730-x | Automatic electrical controls for household and similar use   |
| -                                     | Electromagnetic compare   | tibility  | For use in residential, commerce, light-industrial  |
|                                       | (Applications)  | -         | and industrial environments   |
| -                                     | EU conformity (CE)  |           | CA1T4454xx *)   |
| -                                     | EAC conformity  |           | Eurasia conformity  |
| -                                     | Pressure Equipment Dir  | rective   | PED 2014/68/EU  |
| -                                     | Pressure Accessories  |           | Scope: Article 1, section 1   |
|                                       |   |           | Definitions: Article 2, section 5   |
| -                                     | Fluid group 2: DN 80  | ), DN 100 | Category I, module A, with CE-marking   |
|                                       |   |           | as per article 14, section 2  |
| Environmental compatibility           |   |           | The product environmental declaration E4454 *)<br>contains data on RoHS compliance, materials<br>composition, packaging, environmental benefit,<br>disposal   |

| General       |            |
|---------------|------------|
| environmental | conditions |

|                       | Operation    | Transport    | Storage      |
|-----------------------|--------------|--------------|--------------|
|                       | EN 60721-3-3 | EN 60721-3-2 | EN 60721-3-1 |
| Climatic conditions   | Class 3K5    | Class 2K3    | Class 1K3    |
| Temperature           | 2+50 °C      | -25+70 °C    | -5+45 °C     |
| Humidity              | 595 % r.h.   | 595 % r.h.   | 595 % r.h.   |
| Mechanical conditions | EN 60721-3-6 |              |              |
|                       | Class 6M2    |              |              |

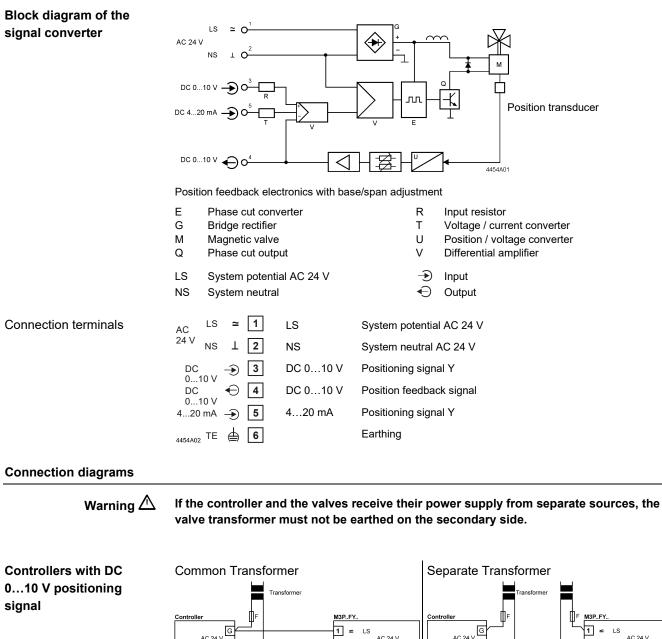




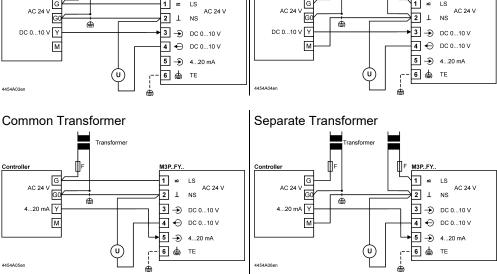

Indication of valve position (only if required). DC 0 ...10 V  $\rightarrow$  0...100 % volumetric flow V<sub>100</sub>

()

All dimensions in mm

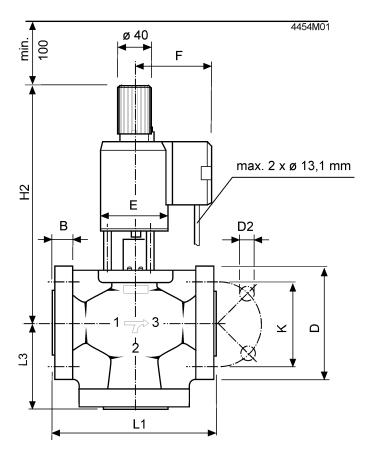

| Type reference | DN  | в  | D   | D2   | к   | L1  | L3  | H2   | Е   | F   | Weight |
|----------------|-----|----|-----|------|-----|-----|-----|------|-----|-----|--------|
|                |     |    | ø   | Ø    | ø   |     |     | min. | Ø   |     | [kg]   |
| M3P80FY        | 80  | 22 | 200 | 8x18 | 160 | 310 | 140 | 508  | 145 | 124 | 45.5   |
| M3P100FY       | 100 | 24 | 220 | 8x18 | 180 | 350 | 160 | 570  | 145 | 124 | 59.0   |
| M3P80FYP       | 80  | 22 | 200 | 8x18 | 160 | 310 | 140 | 508  | 145 | 124 | 45.5   |
| M3P100FYP      | 100 | 24 | 220 | 8x18 | 180 | 350 | 160 | 570  | 145 | 124 | 59.0   |

Remarks:

• Counter-flanges must be supplied by the installer!

• Flange dimensions to ISO 7005-2

#### **Revision numbers**

| Type reference | Valid from manufacturing date | Type reference | Valid from manufacturing date |
|----------------|-------------------------------|----------------|-------------------------------|
| M380FY         | 12/09 <sup>1)</sup>           | M380FYP        | 12/09 <sup>1)</sup>           |
| M3P100FY       | 12/09 <sup>1)</sup>           | M3P100FYP      | 12/09 <sup>1)</sup>           |

<sup>1)</sup> MMYY = Month, Year of manufacturing

Published by: Siemens Switzerland Ltd. Smart Infrastructure Global Headquarters Theilerstrasse 1a 6300 Zug Switzerland Tel. +41 58-724 24 24 www.siemens.com/buildingtechnologies 10/10

© Siemens Switzerland Ltd 2010 Delivery and technical specifications subject to change