
SIEMENS



Room Temperature Sensor QAA64

Vandalproof though concealed mounting

Use	
	Acquisition of room temperature in spaces where the detector needs to be protected against damage or destruction by people. Such spaces are public buildings like schools, administrative buildings, multi-purpose halls, etc.
Ordering	
	Indicate device name and type designation on order: Room temperature sensor QAA64
Equipment combinations	
	All systems and devices that are capable of acquiring and handling the sensor's analog passive LG-Ni 1000 output signal.
Function	
	The sensor acquires the air temperature via its sensing element whose resistance changes as a function of the temperature. The signal is delivered to a suitable controller for further handling.

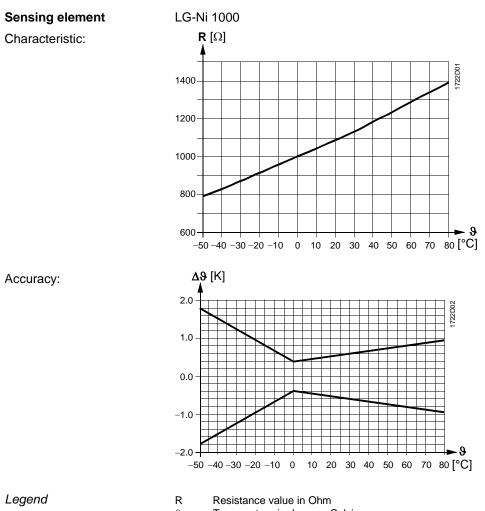


9 Temperature in degrees Celsius
Δ9 Temperature differential in Kelvin

Mechnical design

The QAA64 has been designed specifically for installation on recessed conduit boxes having a fixing hole circle dia. of 60 or 69 mm.

The unit consists of a plastic cover and a fixing bracket made of metal. The rear of the cover carries the connecting terminal strip and a measuring element LG-Ni 1000. The fixing bracket is fitted inside the recessed conduit box. A captive screw is used to secure the cover to the bracket.



2/4

For the permissible lengths of lines and measured value errors, refer to "Basic System Data" of the respective control system. If, for some reason, the detector cannot be mounted in a location where it can correctly acquire the room temperature, a resistor can be mounted to correct or adjust the measurement. For this purpose, the detector has an auxiliary terminal (for details, contact SBT service personnel).

Fitting and installation notes

Location	On an inner wall of the space to be heated, if possible on the wall opposite the heating unit. Not in recesseds or shelves, not above or near heat sources. The end of the conduit at the detector must be sealed to prevent false measurements due to draughts through the conduit. The connecting wires are interchangeable.
Installation instructions	Installation instructions are supplied with the unit.
Disposal	
	The devices are considered electronics devices for disposal in terms of European

The devices are considered electronics devices for disposal in terms of European Directive 2012/19/EU and may not be disposed of as domestic waste.

• Dispose of the device via the channels provided for this purpose.

• Comply with all local and currently applicable laws and regulations.

Technical data

Functional data	Measuring range	050 °C
	Sensing element	LG-Ni 1000
	Time constant	6.5 min (depending on air movement and
		thermal coupling to the wall)
	Measuring accuracy	refer to "Function"
	Type of measurement and output	passive
Degree of protection	Protection class	III to EN 60730-1
	Protection degree of housing	IP40 according to EN 60529
Electrical connections	Connecting terminals for	2 x 1.5 mm ² or 1 x 2.5 mm ²
	Perm. cable lengths	refer to "Engineering notes"
Directives and	Product standard	EN 60730-1
Standards		Automatic electrical controls for household and
		similar use
Environmental conditions	Operation	IEC 721-3-3
	Climatic conditions	class 3K5
	Temperature	050 °C
	Humidity	0…95 % r. h. (noncondensing)
	Mechanical conditions	class 3M2
	Transport	IEC 721-3-2
	Climatic conditions	class 2K3
	Temperature	−25+65 °C
	Humidity	<95 % r. h.
	Mechanical conditions	class 2M2

3/4

Environmental compatibility


The product environmental declaration CE1E1701^{*)} contains data on environmentally compatible product design and assessments (RoHS compliance, materials composition, packaging, environmental benefit, disposal).

Materials and colors

Cover	insulating plastic, RAL 9010 (pure white)	
Fixing bracket	Steel, nickel-plated	
Packaging	grey cardboard	
Sensor (complete assembly)	silicone-free	
Incl. packaging	approx. 0.06 kg	


Internal diagram

Weight



- B1 Room temperature measuring signal
- M Measuring neutral
- Rx Auxiliary terminal

Dimensions

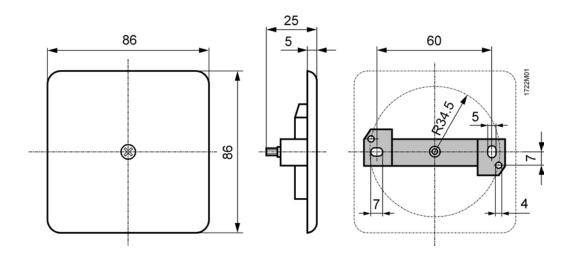

Dimensions in mm

Subject to change